





PRODUCT INFORMATION

WARNING

DEATH OR SERIOUS INJURY CAN OCCUR ON THIS EQUIPMENT. FOLLOW THESE PRECAUTIONS TO AVOID INJURY!

1. Keep children under the age of 14 away from this strength training equipment. Teenagers must be supervised at all times while using this equipment.
2. This equipment is not intended for use by persons with reduced physical, sensory or mental capabilities, or lack of experience and knowledge, unless they have been given supervision or instruction concerning use of the equipment by a person responsible for their safety.
3. All warnings and instructions should be read and proper instruction obtained prior to use. Use this equipment for its intended purpose ONLY.
4. Inspect the machine before use. DO NOT use machine if it appears damaged or inoperable.
5. Do not exceed weight capacity of this equipment.
6. Check to see that the selector pin is completely inserted into the weight stack.
7. NEVER use the machine with the weight stack pinned in an elevated position.
8. NEVER use dumbbells or other means to incrementally increase the weight resistance. Only use the means provided directly from the manufacturer.
9. Injuries to health may result from incorrect or excessive training. Cease exercise if you feel faint or dizzy. Obtain a medical exam before beginning an exercise program.
10. Keep body, clothing, hair, and fitness accessories free and clear of all moving parts.
11. Adjustable stops, where provided, must be used at all times.
12. When adjusting any adjustable mechanism (stop position, seat position, pad location, range of motion limiter, pulley carriage, or any other type), make certain that the adjustable mechanism is fully engaged prior to use to prevent unintended motion.
13. Manufacturer recommends that this equipment be secured to the floor to stabilize and eliminate rocking or tipping over. Use a licensed contractor.
14. If equipment is NOT secured to floor: NEVER allow resistance straps, ropes or other means to be attached to this equipment, as this may result in serious injury. NEVER use this equipment for support during stretching, as this may result in serious injury.
15. DO NOT REMOVE THIS LABEL. REPLACE IF DAMAGED OR ILLEGIBLE.

MODES OF USE

1. ISOMETRIC

- Muscle contraction without movement against a static weight
- How to: choose a fixed numbered position for the range limiter under the carriage by pulling the pin and sliding range limiter to the desired position. Move the weight stack disengagement lever to the “unlocked” position. Switch the carriage lock-out lever to the “locked” position. Gently slide carriage back until it locks in position.

2. LOADED ISOMETRIC

- Muscle contraction without movement holding resistance from the weight stack at a fixed position
- How to: choose a fixed numbered position for the range limiter under the carriage by pulling the pin and sliding range limiter to the desired position. Switch the carriage lock-out lever to the “unlocked” position. Choose the loaded weight at the weight stack and gently slide carriage back until contacting the range limiter. Hold the weight at the fixed position.

3. ISOTONIC

- Muscle contraction through a desired range of motion, with or without limitation of movement, using the weight stack as the resistance mechanism.
- How to: Pin your desired weight stack resistance and perform exercise through a desired range of motion using slow, controlled movements.

4. PLYOMETRIC

- Explosive movement training or “jump training”.
- How to: choose your elastic band strength and wrap the band (or bands) through the blue band pegs on the outside of the frame. Move the weight stack disengagement lever to the “unlocked” position. Perform your plyometric exercise as desired.
- *****CAUTION***** Take note of the range limiting device location. Manufacturer suggests positioning the limiting device in the last position to reduce the chances of a sudden stop of the carriage during explosive movements.

5. ELASTIC

- A form of isotonic training using bands as the primary form of resistance creating increasing loads as the range of motion increases.
- How to: choose your elastic band strength and wrap the band (or bands) through the blue band pegs on the outside of the frame. Move the weight stack disengagement lever to the “unlocked” position. Perform exercise through a desired range of motion using slow, controlled movements.

6. COMBINED (ELASTIC & WEIGHT STACK)

- Using elastic bands and the weight stack of the machine to produce resistance at the same time.
- How to: choose your elastic band strength and wrap the band (or bands) through the blue band pegs on the outside of the frame. Move the weight stack disengagement lever to the “locked” position. Pin your desired weight stack resistance. Perform exercise through a desired range of motion using slow, controlled movements.



PRODUCT INFORMATION

IMPORTANT SAFETY INFORMATION

It is the sole responsibility of the purchaser of MATRIX products to instruct all individuals, whether they are the end user or supervising personnel on proper usage of the equipment.

It is recommended that all users of MATRIX exercise equipment be informed of the following information prior to its use.

Do not use any equipment in any way other than as designed or intended by the manufacturer. It is imperative that MATRIX equipment be used properly to avoid injury.

INSTALLATION

1. **STABLE AND LEVEL SURFACE:** MATRIX exercise equipment must be installed on a stable base and properly leveled.
2. **SECURING EQUIPMENT:** Manufacturer recommends that all stationary MATRIX strength equipment be secured to the floor to stabilize equipment and eliminate rocking or tipping over. This must be performed by a licensed contractor.
3. Under no circumstances should you slide equipment across the floor due to risk of tipping. Use proper materials handling techniques and equipment recommended by OSHA.

All anchor points must be able to withstand 750 lbs. (3.3 kN) pull-out force.

MAINTENANCE

1. DO NOT use any equipment that is damaged and or has worn or broken parts. Use only replacement parts supplied by your country's local MATRIX dealer.
2. **MAINTAIN LABELS AND NAMEPLATES:** Do not remove labels for any reason. They contain important information. If unreadable or missing, contact your MATRIX dealer for a replacement.
3. **MAINTAIN ALL EQUIPMENT:** Preventative maintenance is the key to smooth operating equipment as well as keeping your liability to a minimum. Equipment needs to be inspected at regular intervals.
4. Ensure that any person(s) making adjustments or performing maintenance or repair of any kind is qualified to do so. MATRIX dealers will provide service and maintenance training at our corporate facility upon request.

ADDITIONAL NOTES

This equipment should only be used in supervised areas where access and control is specifically regulated by the owner. It is up to the owner to determine who is allowed access to this training equipment. The owner should consider a user's: degree of reliability, age, experience, etc.

This training equipment meets industry standards for stability when used for its intended purpose in accordance with the instructions provided by the manufacturer.

This equipment is for indoor use only. This training equipment is a Class S product. This training equipment is in compliance with EN ISO 20957-1 and EN 957-2.

NOTE

1. Ambient temperature for operating this equipment is 5°C - 40°C (with NO air-flow), nominal 25°C.
2. Relative Humidity for operating this equipment is 10% - 90% (non-condensing), nominal 40% (non-condensing).
3. Ambient temperature for shipping and storage this equipment is from -20°C to 70°C (with NO air-flow).
4. The barometric pressure for operating/storage/transportation of this equipment should be between 70kPa~106kPa.
5. Relative Humidity for shipping/storage is 10% - 90% (non-condensing).
6. Please dispose of the scrap according to local laws and regulations.



- Operating Instructions



- JOHNSON INDUSTRIES (SHANGHAI) CO., LTD.
No. 2217 Hechen Rd,
Jiading, Shanghai, China



PRODUCT INFORMATION

INTENDED USE

The intended use of the Matrix MD-S70 Leg Press is to help users of all kinds — regardless of age, injury or physical limitation — build strength in the lower extremities for healthy movement. The physical activity level is generated by the user pushing against a stationary foot plate to move the seat against a chosen resistance. Alternatively, both the foot plate and the seat may be locked into stationary positions, allowing the user to perform isometric exercises. The stress intensity of the physical activity level can be changed by adjusting the amount of resistance applied to the chair.

Metabolic System: The MD Leg Press can be used to influence the metabolic system to increase fat-burning, thereby reducing the size of adipose tissue deposits.


Physical Performance Tests: The defined stress intensity of the physical activity level can be used to perform physical performance tests on the strength of the user's leg muscles.

Recovery: Under appropriate supervision, the MD Leg Press can be used to improve muscle strength after injury. The handrails and seat of the MD Leg Press can be used for additional security and stabilization of a user.


PROPER USAGE

1. Do not exceed weight limits of the exercise device.
2. If applicable, set safety stops to appropriate height.
3. If applicable, adjust seat pads, leg pads, foot pads, range of motion adjustment, or any other type of adjustment mechanisms to a comfortable start position. Make certain that the adjusting mechanism is fully engaged to prevent unintentional movement and to avoid injury.
4. Sit on bench (if applicable) and get into appropriate position for exercise.
5. Exercise using no more weight than you can safely lift and control.
6. In a controlled manner, perform exercise.
7. Return weight to its fully-supported start position.


BOTH LEGS

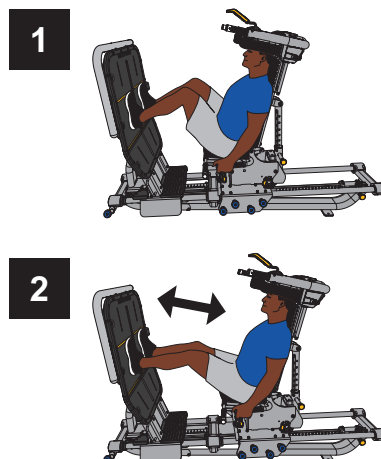

ONE LEG

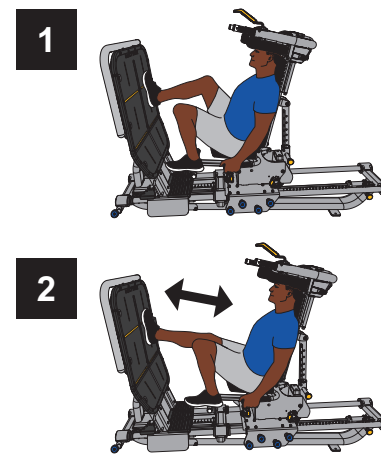


DECLINE POSITION

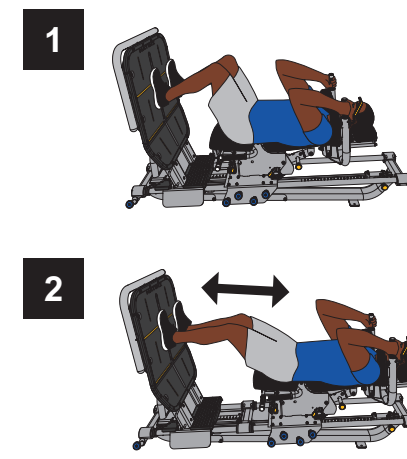



PRODUCT INFORMATION

ADJUSTMENT POINTS

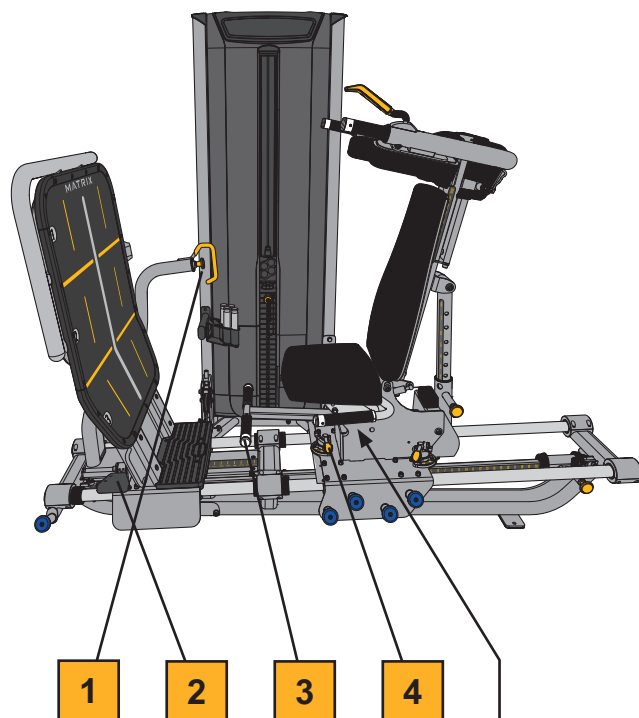


The seat side handles are intended to aid the user to remain in the seat while doing the exercise. The handles are not intended to support the user's complete body weight. Do not apply more than 300 lbs (136 kg) of force to the handles.

1 FOOT PLATFORM STARTING POSITION

Grasp handle, squeeze pin, push or pull platform to desired start position, release pin.

Allows the user to adjust the starting position of the footplate. The user pulls the pin and slides the platform closer or further away to achieve the desired knee flexion at the start position.

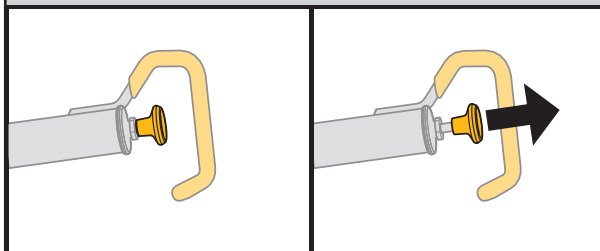


2 Foot Platform Adjustment – Therapist Position

To adjust the foot platform forward or back step down on the adjustment pad, position platform and then release.

Allows the Therapist to adjust the starting position of the footplate. The therapist steps down on the adjustment pad, slides the platform closer or further away from the user to achieve the desired knee flexion at the start position, and then releases the adjustment pad.

*It is easier to do when standing at the rear of the unit versus the side.

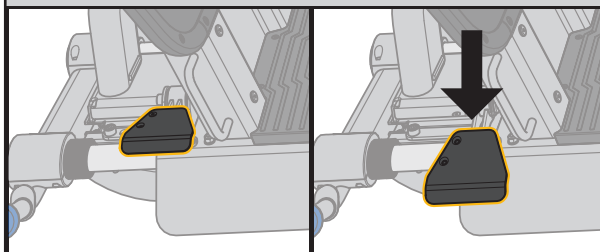


3 Foot Rest

Grasp center of foot rest, pull out to full extension.

Gives the user a place to rest a foot while doing 1-legged exercises.


The foot rest is not intended to support the user's complete body weight. Do not apply more than 300 lbs (136 kg) to the foot rest.

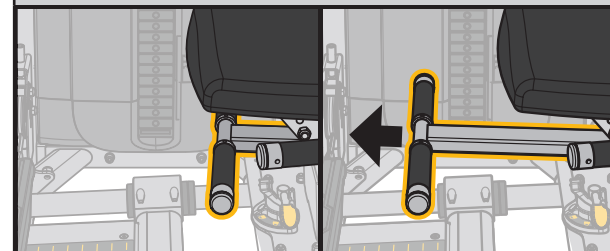

4 Stack Release

To release carriage from the weight stack, grasp handle under seat and rotate to the unlocked position .


This disengages the weight stack from the carriage allowing the user to perform a body weight or band resistance only leg press.

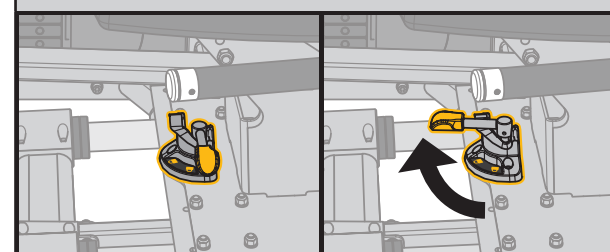




PRODUCT INFORMATION

ADJUSTMENT POINTS

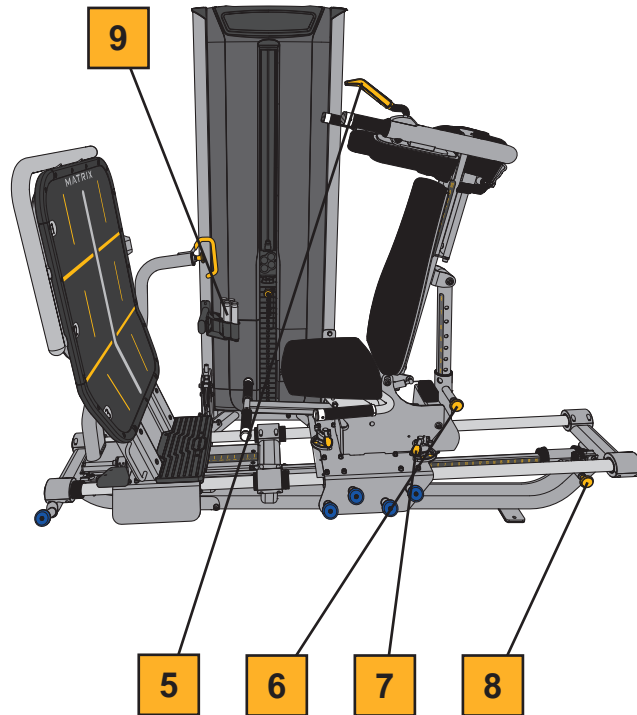

5 Shoulder Pad Adjustment


Squeeze handle down and slide shoulder harness up or down to a comfortable starting position.

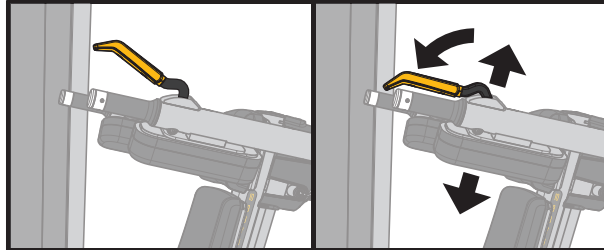

6 Back Pad Adjustment

Pull pin, increase or decrease the angle of the back pad to comfortable start position, release pin.


Allows the user to adjust the starting position of the back pad. The user pulls the pin and slides the back pad closer or further away to achieve a comfortable start position.

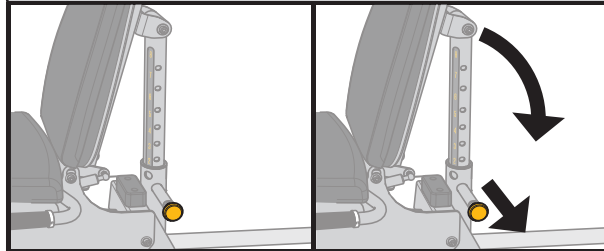

7 Carriage Lock


To lock the carriage into a fixed position, grasp handle and rotate to the lockout position.

By sliding the carriage back to the range limiter position and engaging the carriage lockout, this allows the user to perform isometric exercises.

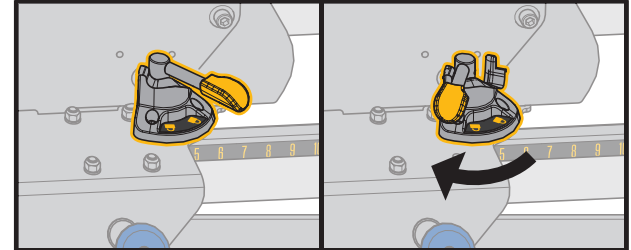


8 Range Limiter

Pull-pin and slide carriage bumper forward or backward to limit the carriage range of motion.

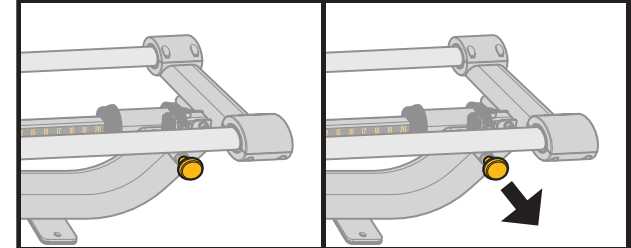

9 0.9 kg / 2 lb Increment Weight (optional)

Remove individual incremental weight pins and insert above head plate to achieve desired starting weight.

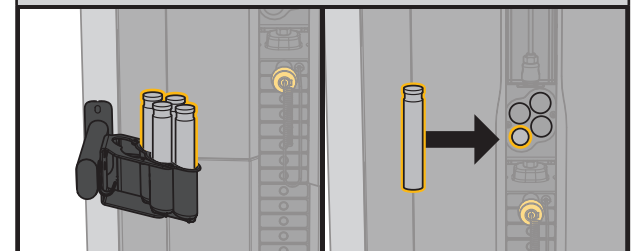



PRODUCT INFORMATION

MAINTENANCE CHECKLIST

ACTION	FREQUENCY
Clean Upholstery ¹	Daily
Inspect Cables ²	Daily
Clean Guide Rods	Monthly
Inspect Hardware	Monthly
Inspect Frame	Bi-Annually
Clean Machine	As Needed
Clean Grips ¹	As Needed
Lubricate Guide Rods ³	As Needed

¹ Upholstery & Grips should be cleaned with a mild soap and water or a non-ammonia based cleaner.

² Cables should be inspected for cracks or frays and immediately replaced if present. If excessive slack exists cable should be tightened without lifting the head plate.

³ Guide rods should be lubricated with Teflon based lubricant. Apply the lubricant to a cotton cloth and then apply up and down the guide rods.

PRODUCT SPECIFICATIONS

Max User Weight	159 kg / 350 lbs
Max Training Weight	139.6 kg / 308 lbs
Product Weight	372 kg / 820 lbs
Weight Stack	136 kg / 300 lbs
Add-On-Weight (optional)	0.9 kg / 2 lbs. effective resistance
Overall Dimensions (L x W x H)*	263.7 x 121.9 x 188.3 cm / 103.8 x 48 x 74.2"

* Ensure a minimum clearance width of 0.6 meters (24") for access to and passage around MA-TRIX strength equipment. Please note, 0.91 meters (36") is the ADA recommended clearance width for individuals in wheelchairs.

WARRANTY

For North America, please visit matrixfitness.com for warranty information along with warranty exclusions and limitations.

TORQUE VALUES

M10 Bolt (Nyloc Nut & Flowdrill)	77 Nm / 57 ft-lbs
M8 Bolts	25 Nm / 18 ft-lbs
M8 Plastic	15 Nm / 11 ft-lbs
M6 Bolts	15 Nm / 11 ft-lbs
Pad Bolts	10 Nm / 7 ft-lbs



ASSEMBLY


UNPACKING

Thank you for purchasing a MATRIX Fitness product. It is inspected before it is packaged. It is shipped in multiple pieces to facilitate the compact packaging of the machine. Prior to assembly, confirm all the components by matching them with the exploded diagrams. Carefully unpack the unit from this box and dispose of the packing materials in accordance with your local laws. Exercise device must be assembled by a trained assembly team or be pre-assembled prior to delivery.

CAUTION


To avoid injury to yourself and prevent damage to the frame components, be sure to have proper assistance removing the frame pieces from this box. Please be sure to install the equipment on a stable base, and properly level the machine. Ensure a minimum clearance width of 0.6 meters (24") for access to and passage around MATRIX strength equipment. Please note, 0.91 meters (36") is the ADA recommended clearance width for individuals in wheelchairs.

MD-S70 TRAINING AREA

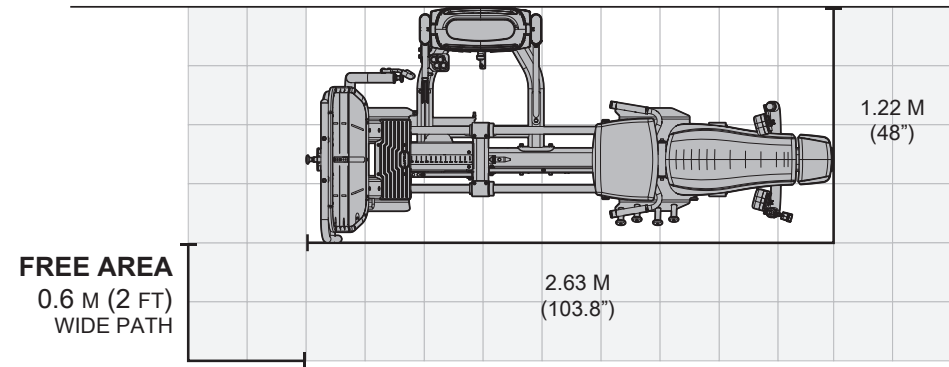

1


Keep pull pin in the lock position

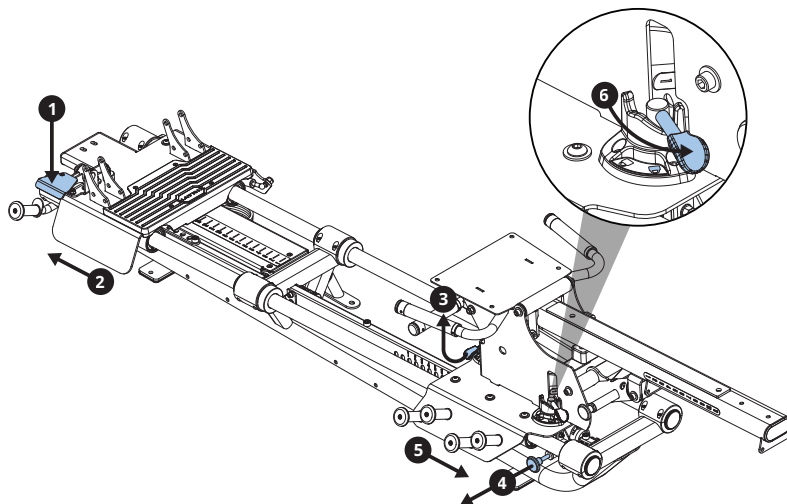

2

Hardware	Qty
A Bolt (M10x150L)	4
B Arc Washer (M10)	8
C Nut (M10)	4
D Hex Head Bolt (M10x20L)	2
E Spring Washer (M10)	2
F Washer (M10)	2

Do not fully tighten frame connectors until assembly is complete. Vibra-Tite 135 Red Gel or equivalent must be used on all fasteners that are not assembled with Nylock Nuts.

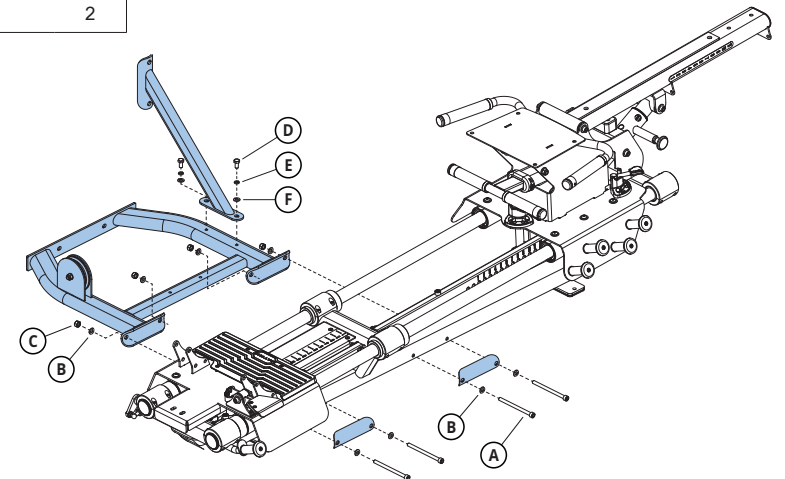




ASSEMBLY

3


Hardware

Qty

D	Hex Head Bolt (M10x20L)	2
E	Spring Washer (M10)	2
F	Washer (M10)	2

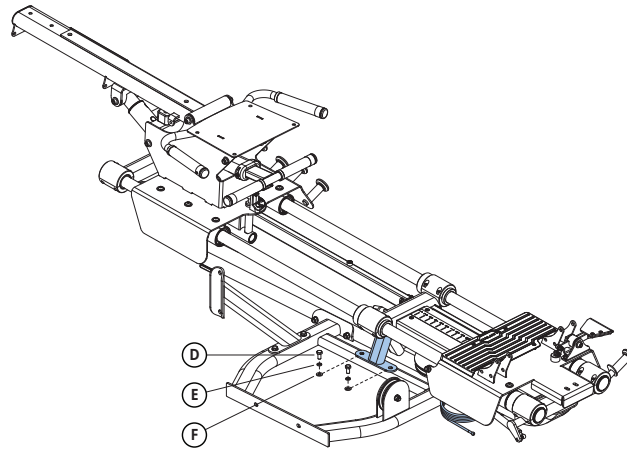

5

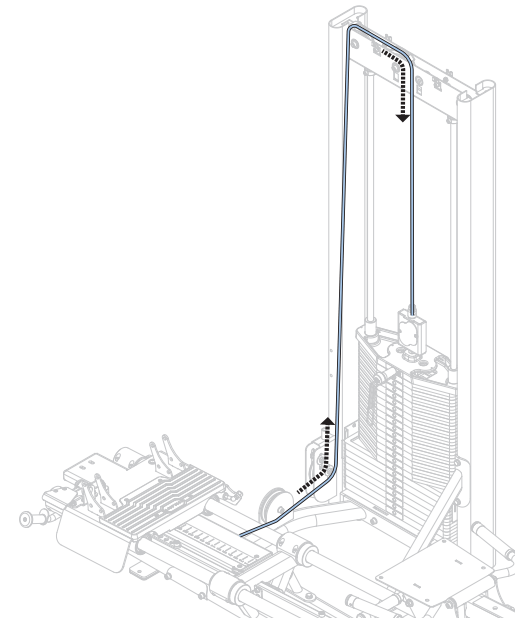


4

Hardware

Qty

B	Arc Washer (M10)	2
D	Hex Head Bolt (M10x20L)	2
E	Spring Washer (M10)	4
F	Washer (M10)	2
G	Socket Head Bolt (M10x20L)	2
H	Pre-installed Nut (M12)	1

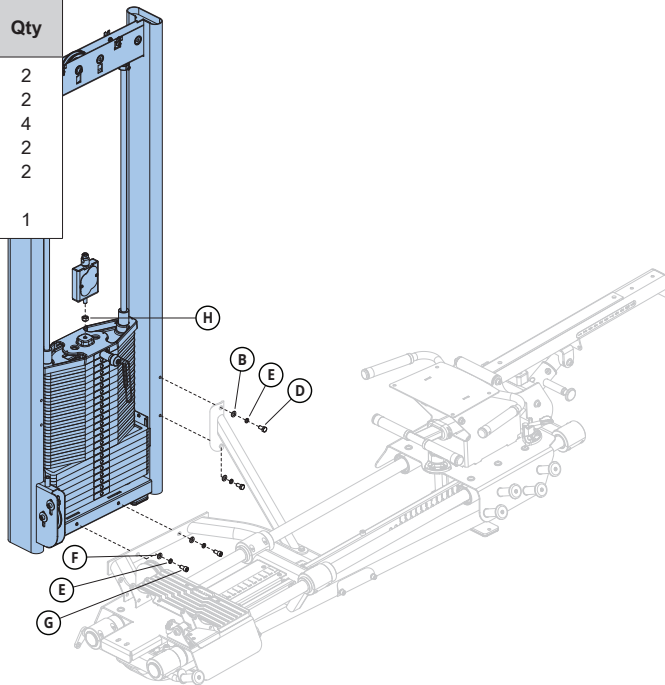


6

Hardware

Qty

C	Nut (M10)	6
F	Washer (M10)	14
I	Bolt (M10x75L)	6
J	Bolt (M10x30L)	2
K	Pre-installed Screw (M5x20L)	4

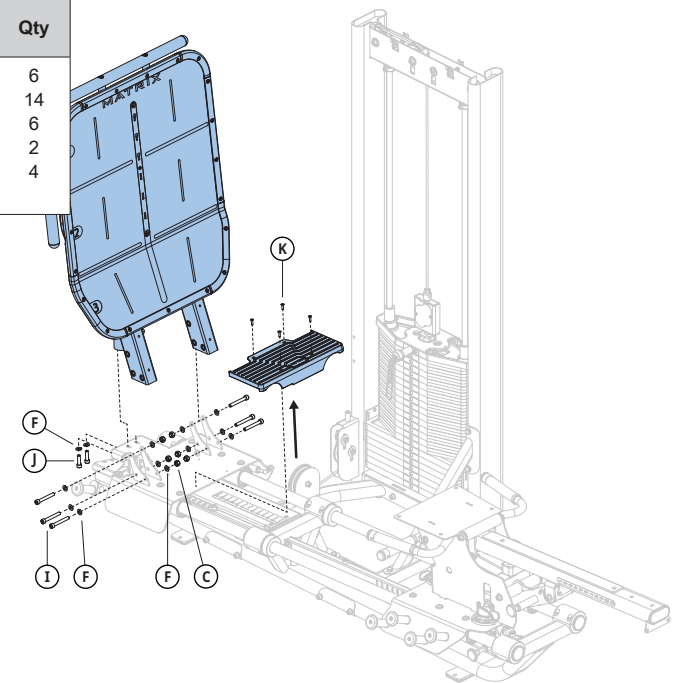




ASSEMBLY

7


Hardware

Qty

F	Washer (M10)	3
G	Socket Head Bolt (M10x20L)	3

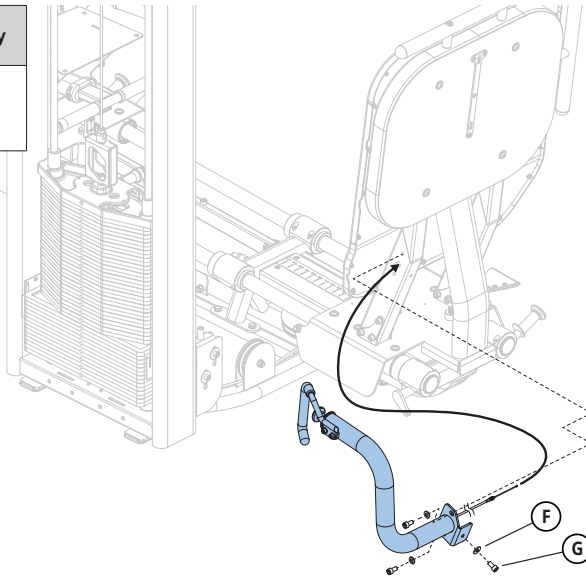

8

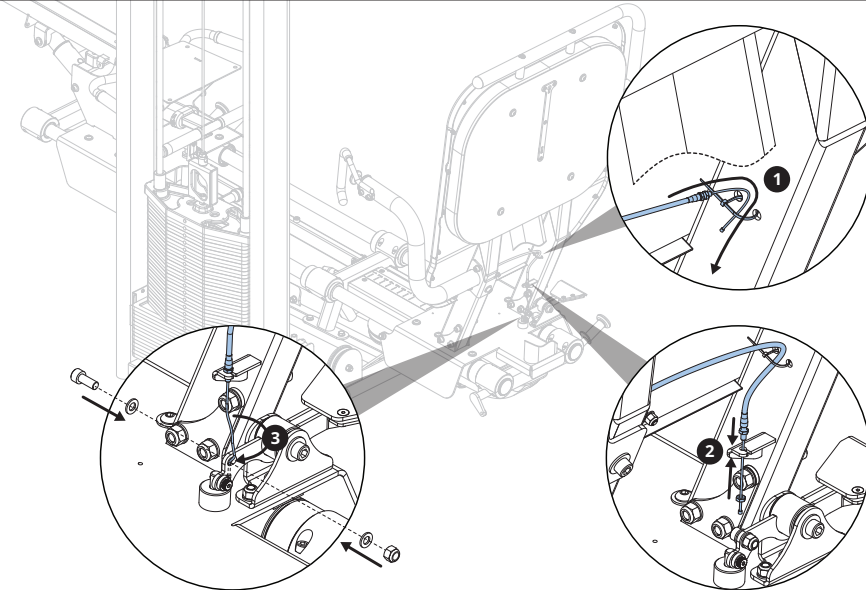


Route cable through hole and attach using pre-installed hardware

9

Hardware

Qty

K	Pre-installed Screw (M5x20L)	4
L	Screw (M8x20L)	4
M	Washer (M8)	4

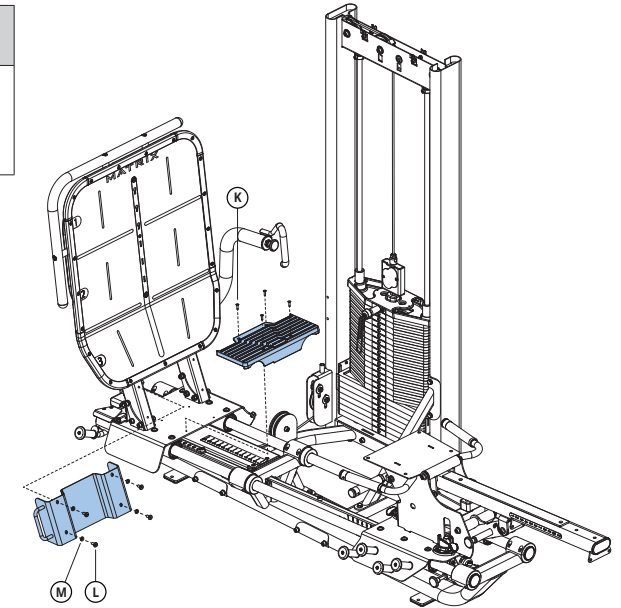


10

Hardware

Qty


F	Washer (M10)	4
G	Socket Head Bolt (M10x20L)	4
N	Socket Head Bolt (M10x25L)	2

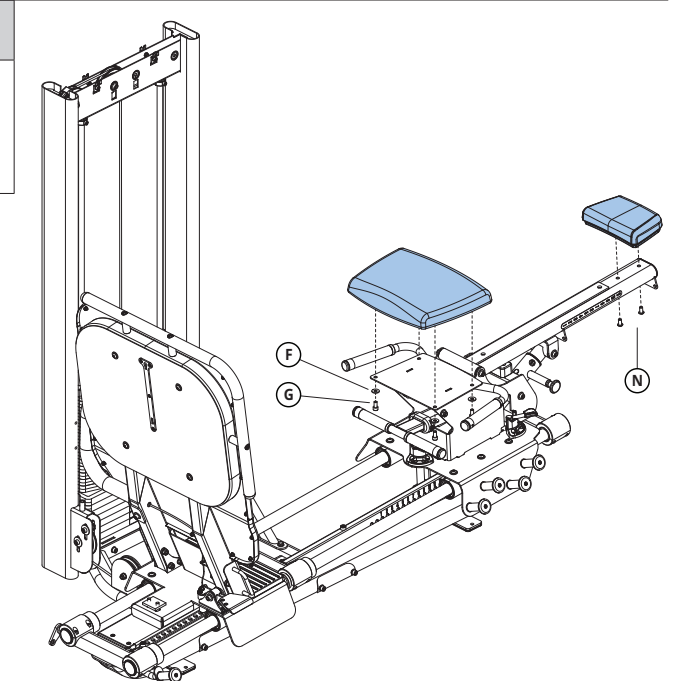




ASSEMBLY

11

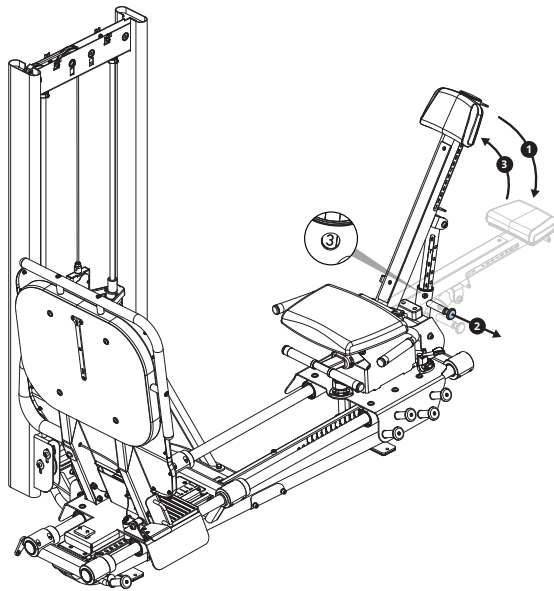


12	Hardware	Qty
N	Socket Head Bolt (M10x25L)	2
O	Plastic Cap	2
P	Bolt (M8x15L)	2
Q	Rubber Stopper	2

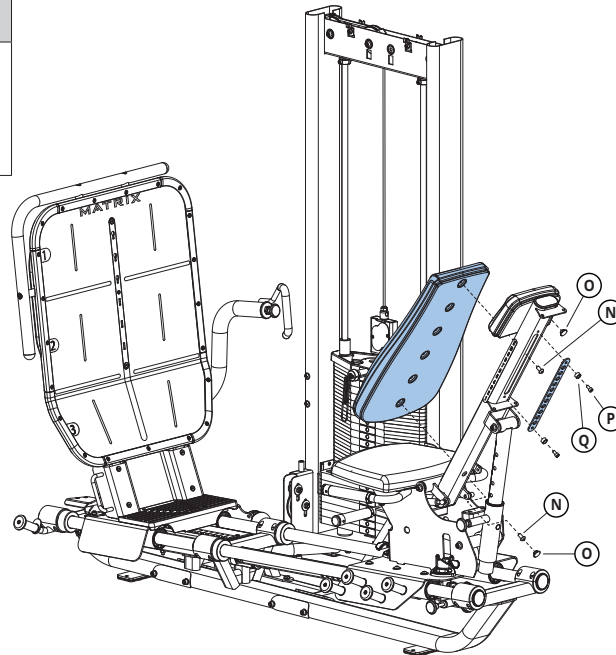

13


Hardware	Qty
D Hex Head Bolt (M10x20L)	2
F Washer (M10)	4
G Socket Head Bolt (M10x20L)	2

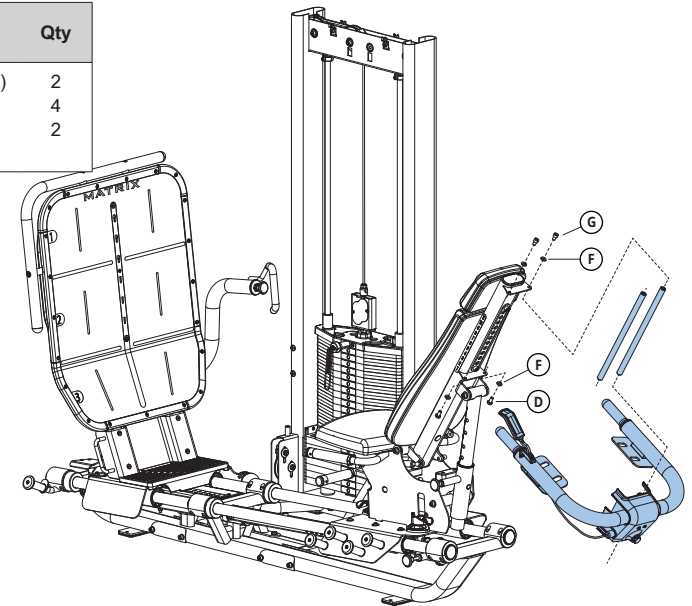

14

Hardware	Qty
R Special Screw	4
S Nylon Washer	4
T Plastic Spacer	4
U Ring	4


Torque Value
2.5 Nm / 22 in -lbs

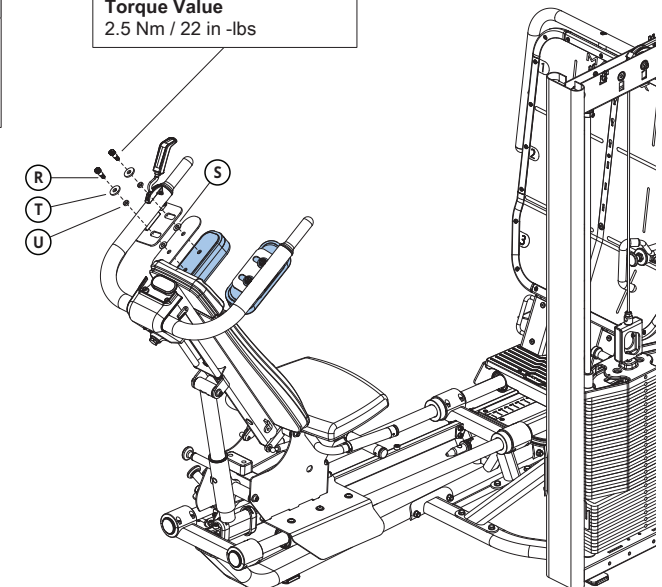





ASSEMBLY

15	Hardware	Qty
F	Washer (M10)	2

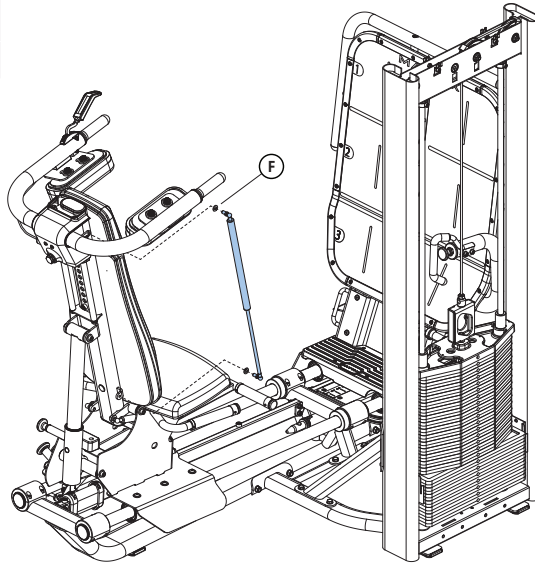

16	Hardware	Qty
M	Washer (M8)	4
V	Bolt (M8x25L)	4

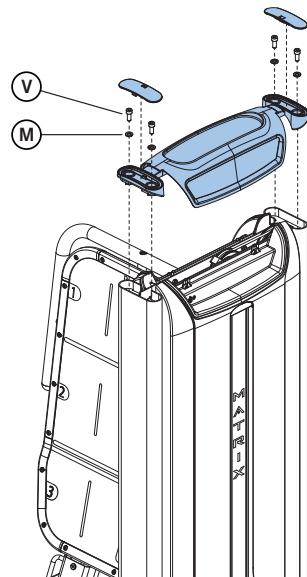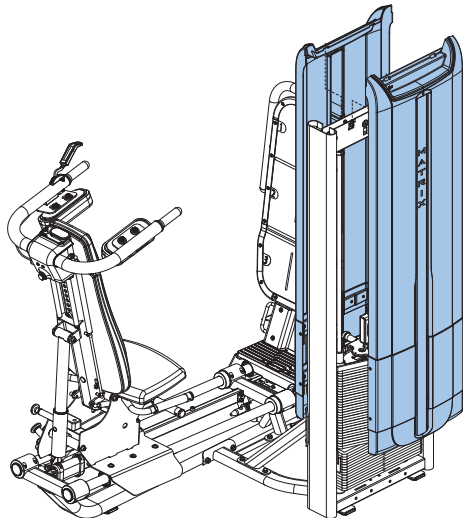


ASSEMBLY COMPLETE


OPTIONAL ASSEMBLY (SOLD SEPARATELY)

BOOSTER KIT

SHOULDER PAD EXTENSION

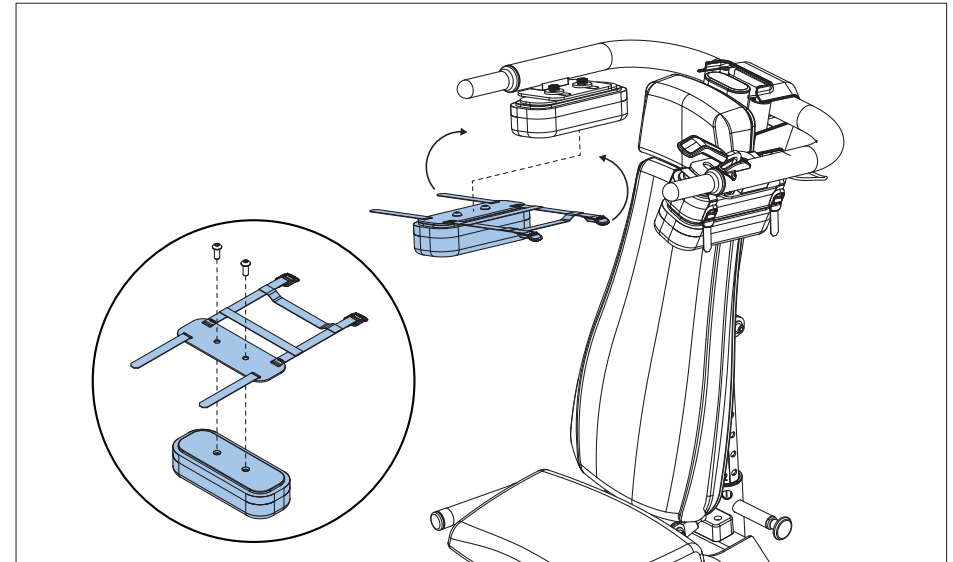


FOOT PLATFORM

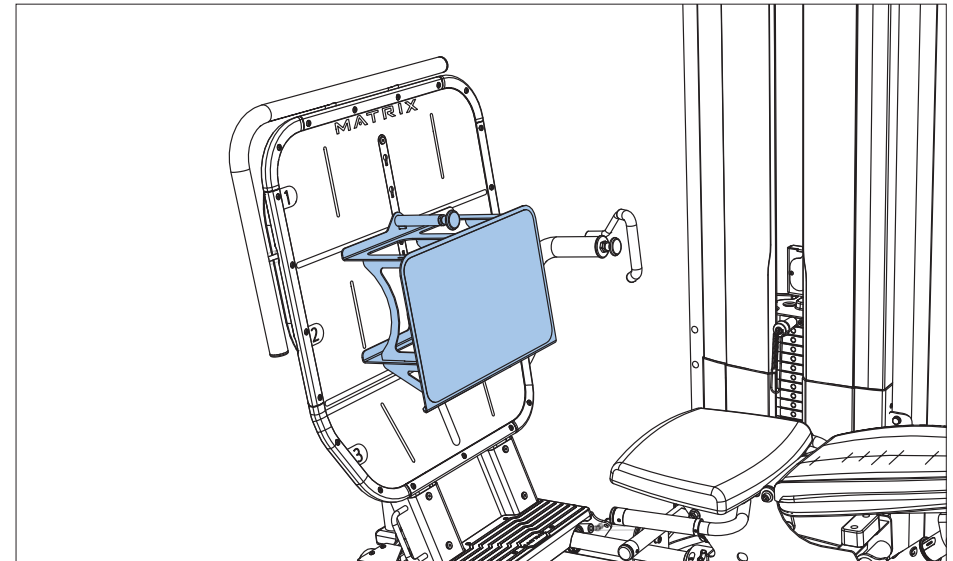





OPTIONAL ASSEMBLY (SOLD SEPARATELY)

INCREMENTAL WEIGHTS

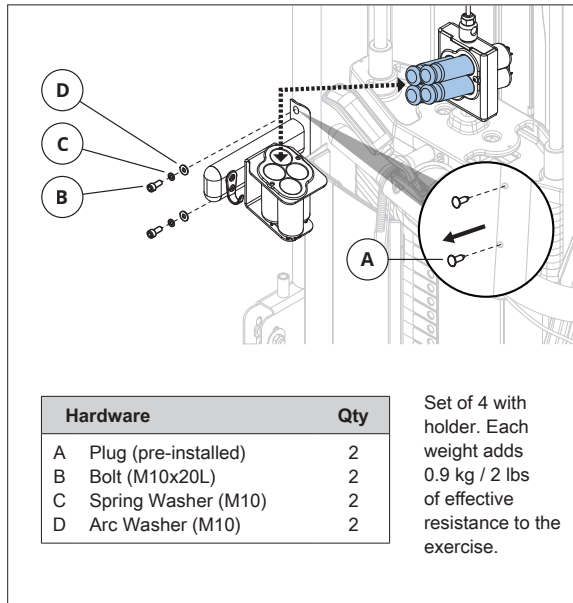


FORCE PLATE HOLDER

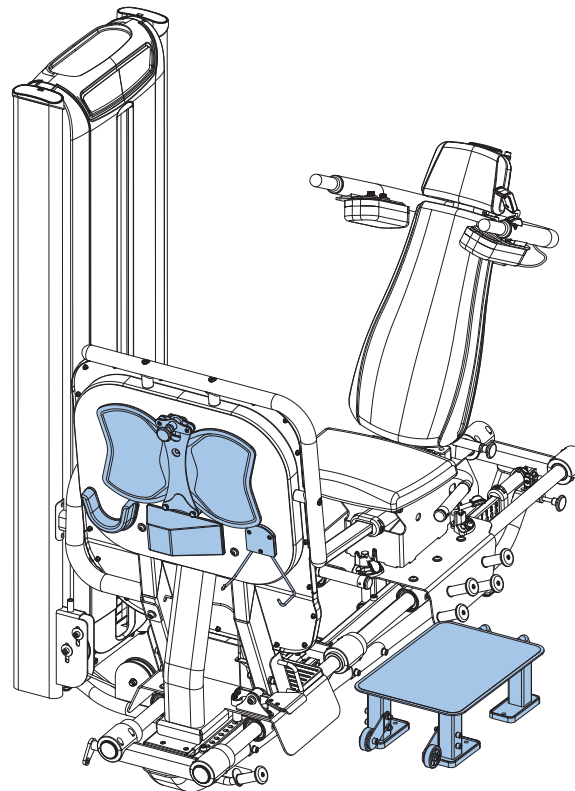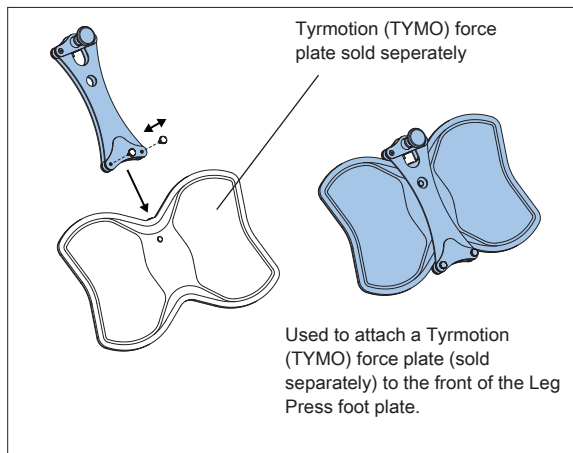

STEP STOOL


Overall Dimensions (L x W x H)

50 x 35 x 16.5 cm
19.7 x 13.8 x 6.5"



Small platform used to help users enter the machine.

ACCESSORY PACK



Contains the following items attached magnetically to the front of the Leg Press foot plate:

- Heel Cup
- Wedge Block
- Wire Mount (holds inflatable disk or balance pad sold separately)

MATRIX



MD-S70

© 2025 Johnson Health Tech

Rev 1.9 A